

**Phoenix**  
DESIGNED FOR YOU



**Phoenix**  
DESIGNED FOR YOU

Tel: 0113 201 2260 Fax: 0113 201 2268  
Email: [sales@phoenix-uk.co.uk](mailto:sales@phoenix-uk.co.uk)  
[www.phoenix-uk.co.uk](http://www.phoenix-uk.co.uk)

**Phoenix Whirlpools Ltd**  
Unit 8, Leeds 27 Ind. Est., Bruntcliffe Ave, Morley, Leeds LS27 0LL

**HFVP001**

Exposed Thermostatic Valve

## INTRODUCTION

---

Your exposed shower valve is a thermostatic mixer which incorporates a thermo-regulating cartridge to assure users of consistent showering temperatures. The valve has been designed & manufactured to comply with BS EN 1111:1999.

This valve complies with the requirements of the above regulations and installation should be carried out in strict compliance with them.

## OPERATING CONDITIONS OF USE

---

Before installation the operating conditions of use must be checked. The table below contains details of the necessary conditions of operation. This valve is suitable for use with the following systems

- Gravity fed Hot & Cold (balanced pressures)
- Gravity fed Hot & mains Cold (balanced pressures)
- Unvented systems
- Gas combination boiler
- Pumped system

Note: On gravity systems the minimum Vertical distance (drop) from the underside of the cold water storage tank to the shower valve must be 2 metres. If water supply is fed by gravity then supply pressure should be verified to ensure the conditions of use are appropriate for the valve

Maximum Static Pressure - BAR	10
Flow Pressure, Hot & Cold - BAR	0.2 to 5
Hot Supply Temperature - °C	55 to 65
Cold Supply Temperature - °C	Equal to or less than 25°C

### Recommended outlet temperatures

The BuildCert TMV scheme recommends the following set maximum mixed water outlet temperatures for use in all premises:

41°C for showers;

The mixed water temperatures must never exceed 46°C.

The maximum mixed water temperature can be 2°C above the recommended maximum set outlet temperatures.

Note: 46°C is the maximum mixed water temperature from the bath tap. The maximum temperature takes account of the allowable temperature tolerances inherent in thermostatic mixing valves and temperature losses in metal baths. It is not a safe bathing temperature for adults or children.

The British Burns Association recommends 37 to 37.5°C as a comfortable bathing temperature for children. In premises covered by the Care Standards Act 2000, the maximum mixed water outlet temperature is 43°C.

The thermostatic mixing valve will be installed in such a position that maintenance of the TMV and its valves and the commissioning and testing of the TMV can be undertaken.

The fitting of strainers is recommended as close as is practicable to the water supply inlets of the thermostatic mixing valve.

## MAINTENANCE

We advise that the valves, check valves and filters be regularly serviced particularly in hard water areas. The check valves along with the filters are contained in the retaining nut. The water supplies must be isolated remotely from the valve before removal.

Valves should be tested against the original set temperature results once a year. When testing is due the following performance checks shall be carried out.

1. Measure the mixed water temperature at the outlet.
2. Carry out the cold fail-safe shut off test by isolating the cold water supply to the TMV, wait for 5 seconds if water is still flowing check that the temperature is below 46 degrees C.
3. If there is no significant change to the set outlet temperature ( $\pm 2^{\circ}\text{C}$  or less change from the original setting) and the fail safe shut off is functioning, then the valve is working correctly and no further service work is required.

If further maintenance should be required contact Phoenix for details. Please see contact details on the back page of this document.

## GUARANTEE

All product guarantees are subject to the following terms and conditions: The product has been fitted/installed in accordance with the appropriate fitting instructions, local bylaws and general good plumbing practice; The product has been maintained and cared for in accordance with the instructions (including regular and appropriate cleaning); If any product has been modified, misused, neglected, wilfully or accidentally damaged then the product guarantee is invalid.

The guarantee on all products is 12 months from the date of supply from Phoenix unless otherwise stated. The guarantee only covers the material structure of products (excluding shattering glass) and not serviceable moving parts that perish due to fair wear and tear such as cartridges, valves, hinges, seals etc.

In the event of a guarantee claim, the liability of Phoenix is limited to the product supplied and does not extend to consequential loss or damage arising from defective product. The guarantee applies to the original purchaser ONLY and is not transferable. This guarantee does not affect your statutory rights and is applicable in the UK and Republic of Ireland. All products installed in a commercial environment carry a 12 month guarantee.

The specifications and prices contained within this material are for information purposes only and, as our products are continually updated, are subject to change without prior notice. We cannot be held responsible for the use of incorrect dimensions shown for first fix without the actual products on site. All dimensions stated in this material are nominal and are subject to manufacturing tolerances.

For technical information and downloadable Data Sheets, please visit: [www.phoenix-uk.co.uk](http://www.phoenix-uk.co.uk)


## VALVE INSTALLATION GUIDELINES AND COMPLIANCE

The valve must be installed so that it is readily accessible for commissioning and maintenance. The valve must be installed with isolation valves on both the hot and cold water systems as close as possible to the valve; so as to allow the valve to be commissioned and tested correctly. The valve is fitted with integral check valve cartridges which command the water supply, therefore the thermostatic valve is protected against cross-flow due to unbalanced line pressures as required by the Water Supply (Water Fittings) Regulations 1999.


Most problems associated with the operation of thermostatic shower valves are caused by debris in the new pipe work getting into the thermostat. These problems are easily avoided by thoroughly flushing the pipe work BEFORE the shower valve is fitted

## GENERAL DIMENSIONS

Dual Function

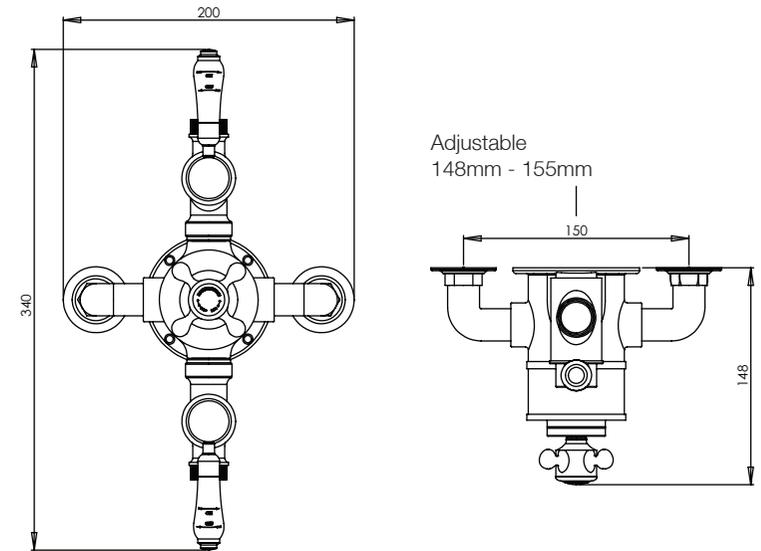


Single Function


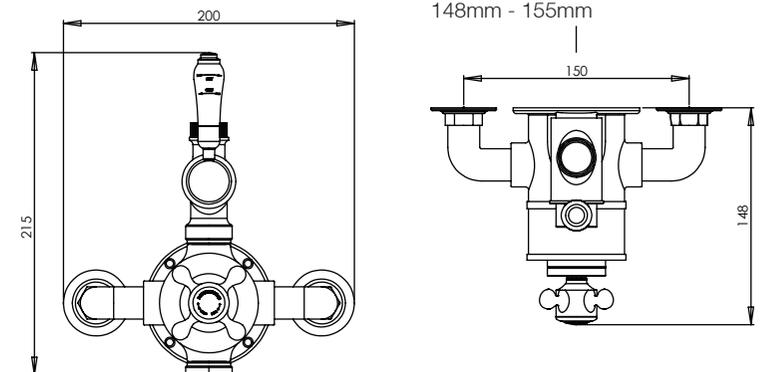


## PRODUCT COMPONENTS

Should you require any replacement components for this product please contact Phoenix using the contact details on the back page of this instruction document

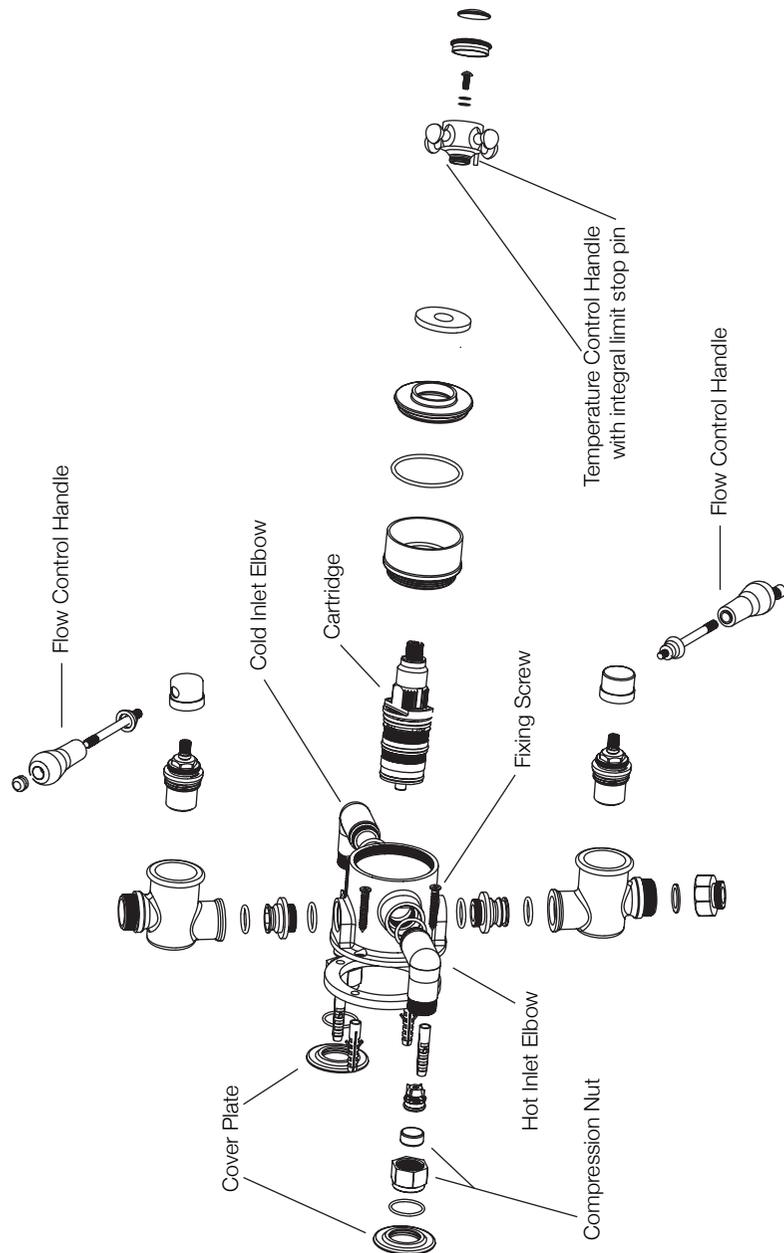


## SETTING TEMPERATURE (CONTINUED)

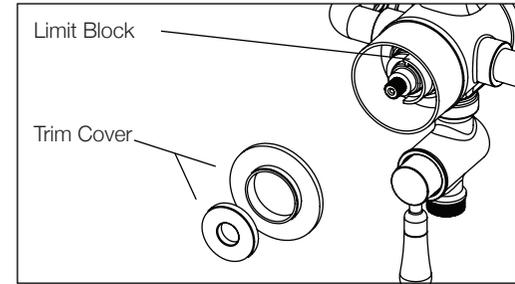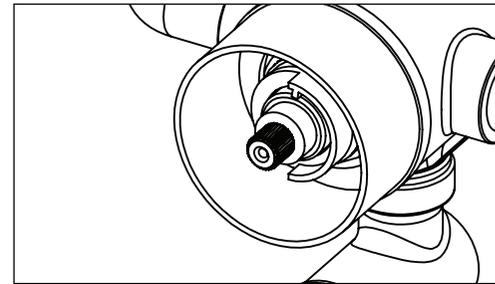

4. Turn on the water
5. Slowly turn the spindle by hand until the required max temperature is achieved

6. Without rotating the temperature spindle, replace the temperature control handle so that the integral limit stop pin is positioned to the right of the wall of the limit block inside the valve.
7. Replace the trim cover and refit and tighten the handle.

Make sure the arm of limit stop is positioned to the right of the limit block

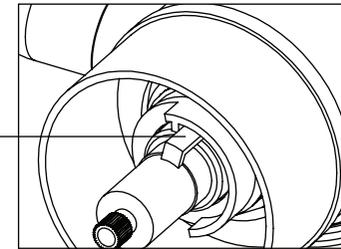

## TROUBLE-SHOOTING

PROBLEM	SOLUTION
Shower will not run hot enough when first installed	Check for debris Check hot water temperature and boiler function
Cold water running back through the valve into the hot water system.	Check the filters and check valves are functioning correctly.
Shower only runs cold.	Check hot and cold pipework is installed to correct inlet on the valve

If you require further assistance beyond the guide below contact the help line on 0113 201 2260

## AFTERCARE INSTRUCTIONS

Whilst this item has a high quality durable finish, it should nevertheless be treated with care. Surfaces should be cleaned using only a soft damp cloth and clean water & dried using a soft cotton cloth. Bath / shower cleaning products, even non-scratch ones could damage the finished surface.

## COMMISSIONING

It is important that incoming water supplies conform to the requirements specified for pressure and temperature. Assure that supply water conditions satisfy any guidance information for the control of bacteria and that the designation of the supplied valve suits the application. Do not continue commissioning until supplies are correct and stable considering variation caused by other service users.

Use a calibrated thermometer for testing incoming and mixed water.

1. Record temperature of the incoming hot and cold supply.
2. Record temperature of mixed discharge at maximum draw off rate.
3. Record temperature of mixed discharge at minimum draw off rate.
4. Isolate the cold water supply and measure the mixed water temperature as the cold water failure device reacts. This should deviate by no more than + 2°C of the initial maximum set point. Restore the cold supply and measure the stabilised mixed water temperature. This must not deviate by more than + / - 2°C of the initial set recorded result. Record these findings.
5. Record the measuring equipment used for the measurements.

The above records must be retained and updated during the service life of the valve.

If there is a residual flow during the commissioning or the annual verification (cold water supply isolation test), then this is acceptable providing the temperature of the water seeping from the valve is no more than 2°C above the designated maximum mixed water outlet temperature setting of the valve.

Temperature readings should be taken at the normal flow rate after allowing for the system to stabilise.


The sensing part of the thermometer probe must be fully submerged in the water that is to be tested.

Any TMV that has been adjusted or serviced must be re-commissioned and re-tested in accordance with the manufacturers' instructions.

The installation of thermostatic mixing valves must comply with the requirements of the Water Supply (Water Fittings) Regulations 1999.

## SETTING TEMPERATURE

The temperature control handles on this product are factory set and should require no adjustment. However, if for any reason the handles and/or the cartridge is removed it is important the following procedure is followed.

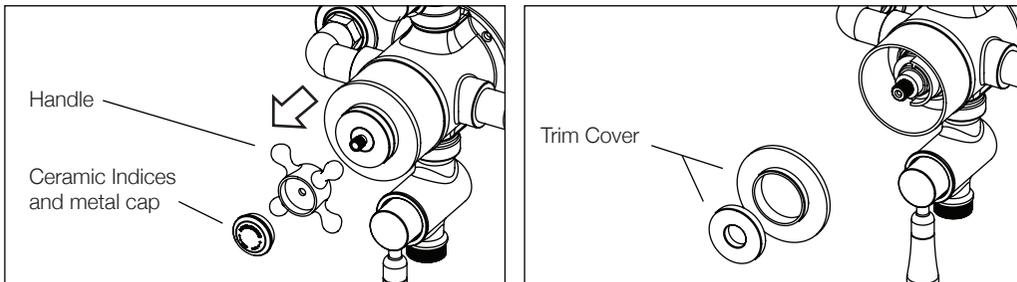


1. Remove the handle by unscrewing the metal cap and the internal screw holding the handle in place.

2. Turn off the water  
3. By hand remove the trim covers from the valve body


## VALVE INSTALLATION

1. Select the valve position considering the overall height of the system including the rigid riser rail and head
2. Prepare the water pipes at 150mm centres
3. The ends of the pipe should be cut 20-35mm out from the wall face
4. Remove the compression nuts and the cover plates from the inlet elbows of the valve
5. Line up the valve with the hot and cold inlet pipes ensuring hot inlet is on the left and cold inlet on the right
6. Whilst holding the valve in position, mark the drill hole positions through the back plate of the valve body
7. Remove the valve and drill 4X8mm holes into the wall to a depth of 45mm and insert wall plugs.
8. Slide the cover plates over the pipes to cover the hole around the pipework
9. Secure the valve to the wall with the fixings supplied and connect the valve to the pipework using the compression fitting and PTFE tape if required
10. Test for leaks

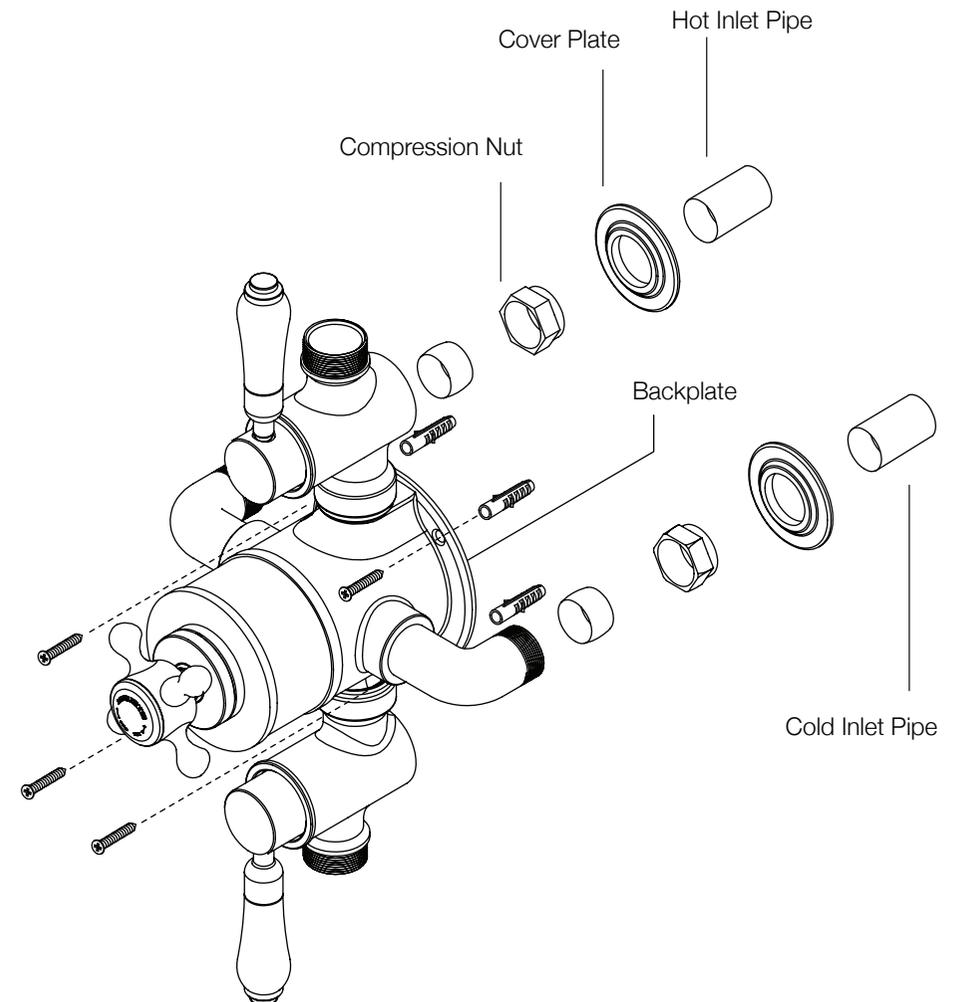


## ACCESSORY INSTALLATION


Please note that the wall plugs supplied are only suitable for solid stone / brick walls. For plasterboard walls use specialist wall plugs.

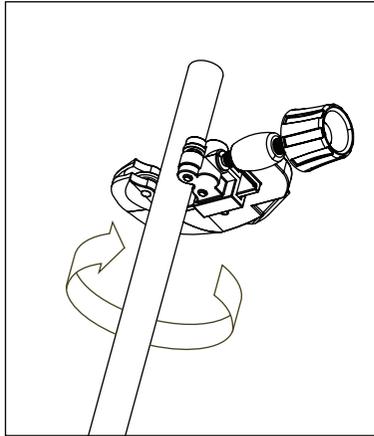



1. This rail can be adjusted in height by cutting the rail tube to the preferred length. Do so BEFORE assembly.

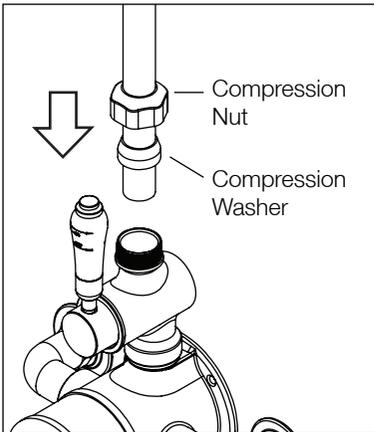


2. Secure the rail to the valve using the compression fitting at the valve body

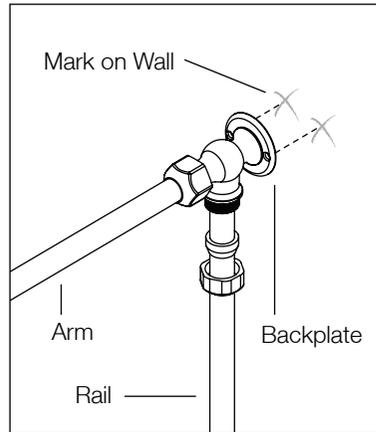

3. Assemble the rail to the wall bracket fixing and mark up the fixing holes for wall attachment

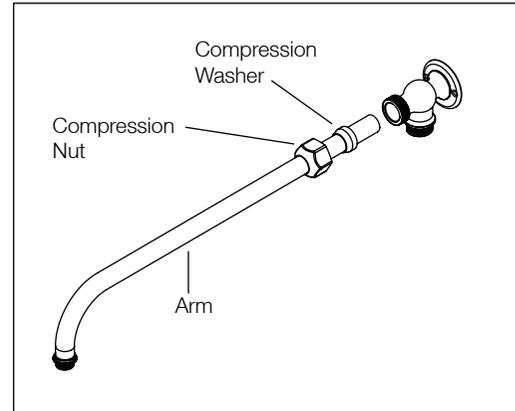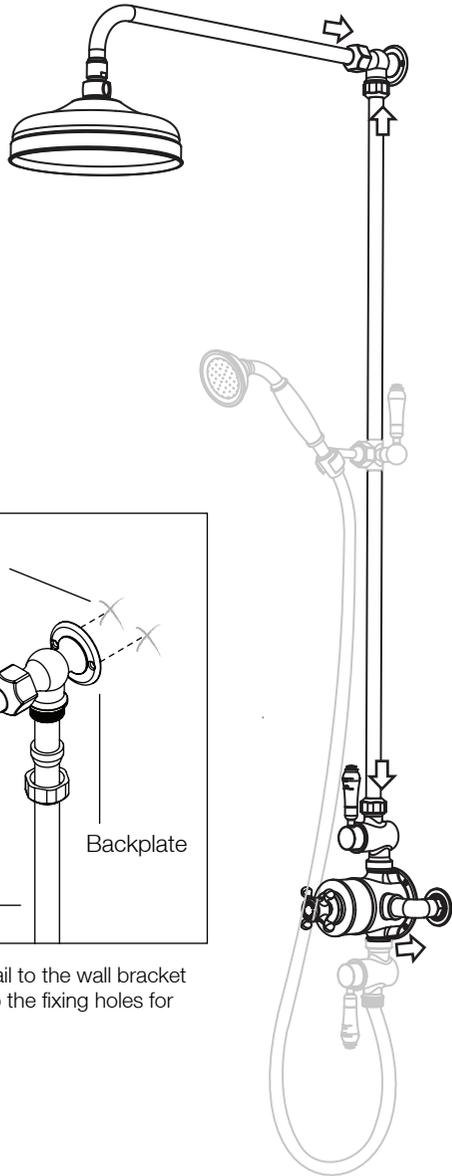

4. The arm can also be adjusted in length by disassembling the elbow fixing and cutting the arm to the preferred length.

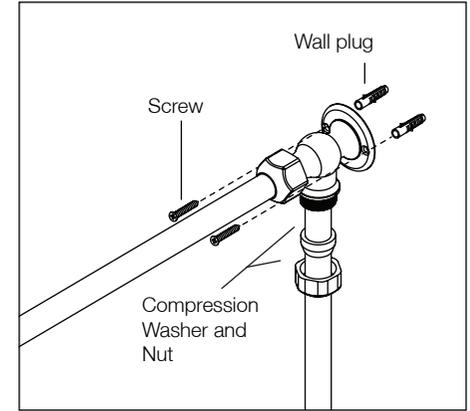

5. Re-insert the arm and screw the backplate tight to the wall (WITH DUAL FUNCTION VALVE MAKE SURE HANDSET HOLDER IS PUT ONTO THE RAIL BEFORE FIXING IN PLACE)

## OPERATING

1. Turn the water flow control handle to increase/decrease the flow and turn on/off.
2. Turn the temperature control handle to increase/decrease the water temperature
3. The temperature control knob is pre-set to auto stop at above 44°C to avoid scalding. However, if for any reason the setting is removed it is important to follow "Temperature Setting" procedure to reset.

